

TENTERFIELD SHIRE COUNCIL

POLICY STATEMENT

HEADING:

Construction over Stormwater, Water and Sewer Mains Policy

MEETING ADOPTED AND RESOLUTION NO.:

**23 August 2017
168/17**

HISTORY OF DOCUMENT PREVIOUSLY ADOPTED:


26 March 2014 77/14

Policy:

Generally, no construction is permitted within 1.5m either side of an underground Council service main for Stormwater, Sewer or Water, or within a zone extending from 45 degrees either side of the pipe from the pipe invert to the ground surface (refer figure 1), whichever is the greater.

The reason for the specified exclusion zone is to necessitate safe access. The 45 degree zone of influence is to allow Council to bench excavations 1:1 as required by Workplace Health and Safety legislation.

Figure 1 – Schematic of Exclusion Zone

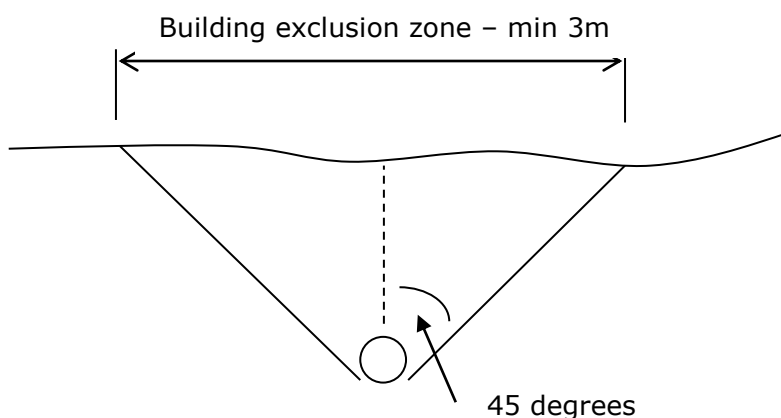

Policy Statement No. 2.030

Date of Effect: 23 August 2017

Name of Policy: Construction of Stormwater, Water & Sewer Mains

Review Date:

August 2020

Responsible Officer:

Chief Operating Officer