




Ø1050 precast access chamber complete with cast iron cover and frame. Roof to be rotated to give MAX access to chamber.

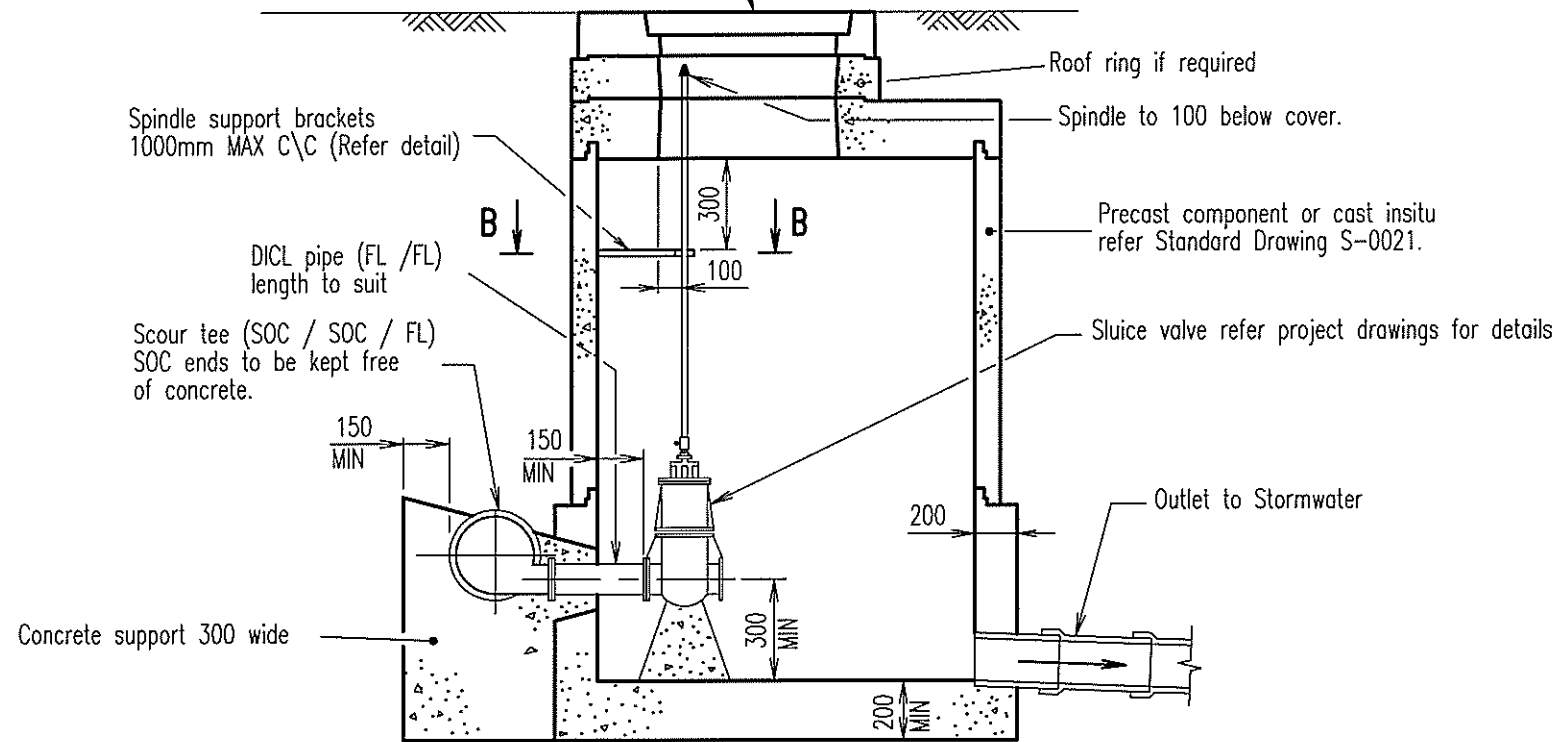

ELEVATION
SCOUR DETAIL AT ACCESS CHAMBER

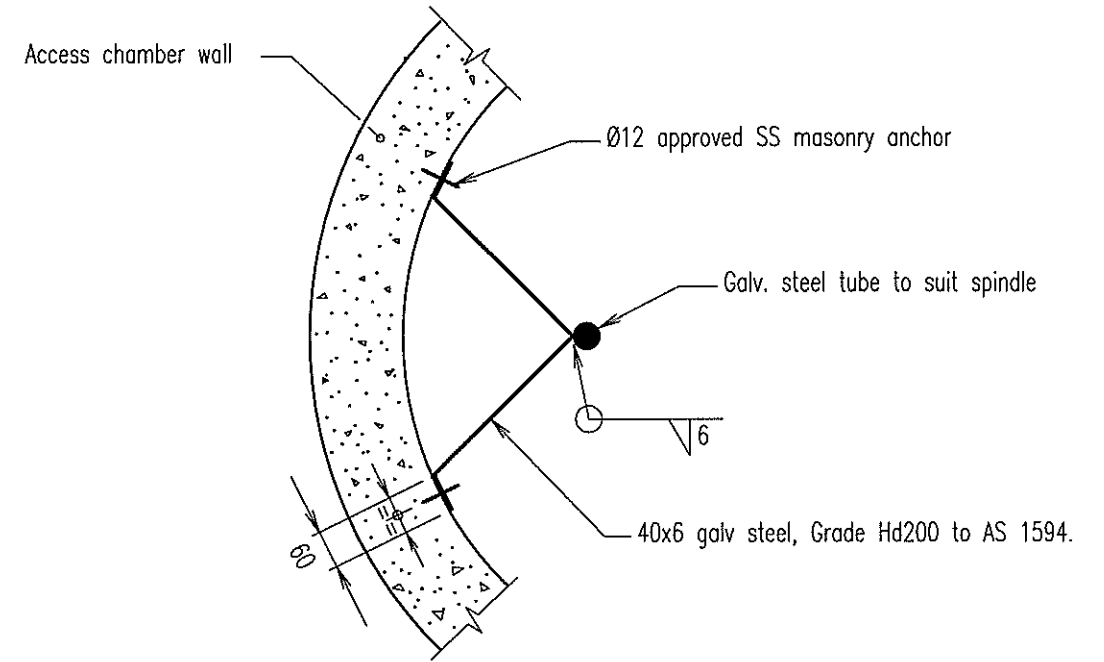

SECTION B-B
BRACKET DETAIL

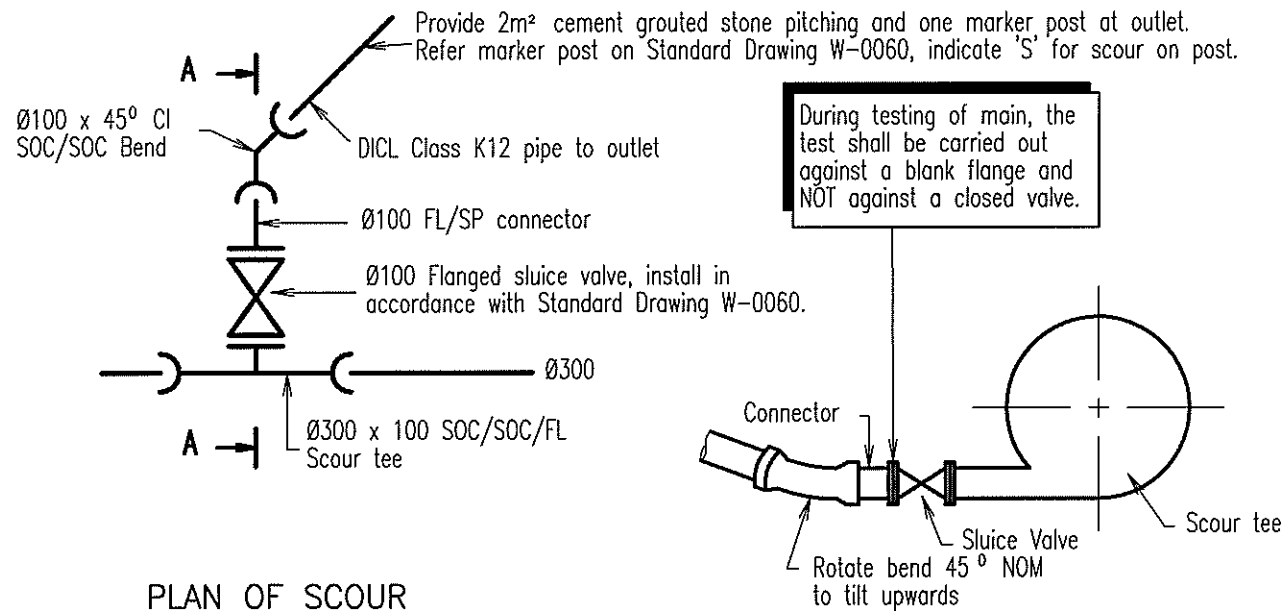

PLAN OF SCOUR

SCOUR DETAIL


SECTIONAL ELEVATION
OF SCOUR TEE AT A-A

NOTES

1. Refer Standard Drawings S-0020 and S-0025 for details of access chambers and covers.
2. Where foundation bearing pressure is less than 50kPa, excavate and replace unsatisfactory material with compacted CBR15 material to the depth ordered by the Superintendent.
3. Concrete N20 in accordance with AS 1379 and AS 3600.
4. All steelwork hot dip galvanized after fabrication to AS 1650.
5. All welds to AS 1554. All welding symbols to AS 1101.3.
6. The location of the scour valve and extent of scour discharge pipe are indicated on project drawings.
7. All dimensions in millimetres.

A	ORIGINAL ISSUE	8/12/95
	REVISIONS	DATE

© INSTITUTE OF PUBLIC WORKS ENGINEER AUSTRALIA QUEENSLAND DIVISION INC. -
DISCLAIMER. The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.



SCOUR DETAILS

WATER
Standard
Drawing
W-0080